



Wels, Jan 21st 2020

RECOMMENDATION ON THE SYSTEM DESIGN OF FRONIUS TAURO ECO

Fronius International GmbH

hereby confirms that, for system designs containing the inverters

- / TAURO ECO 100-3-D, TAURO ECO 100-3-P
- / TAURO ECO 99-3-D, TAURO ECO 99-3-P
- / TAURO ECO 50-3-D, TAURO ECO 50-3-P

The minimum temperature limit can be raised from -10 °C to 0 °C, without voiding the manufacturer's warranty conditions, provided that:

- / the Fronius TAURO ECO is installed in one of the listed countries within the attached country list,
- / the installation location is less than 1000 m above sea level and
- / the PV-modules are not attached on the PV-Tracking System.

Based on extensive analyses of simulation models as well as analyses of installed systems lasting several years, Fronius International GmbH has determined that a cell temperature of -10 °C and a simultaneous insolation of 1000 W/m² will not occur under the aforementioned conditions. Therefore, when the strings and voltage limits are correctly configured in accordance with the operating instructions, no system voltages above 1000 V DC will occur, even with the adapted temperature limits.

Furthermore, the investigations carried out by Fronius International GmbH have shown that a cell temperature of +70 °C can only occur with poorly ventilated solar modules and with an ambient temperature above 30 °C. Fronius International GmbH therefore recommends that the maximum temperature be reduced from 70 °C to 60 °C, provided that

- / the Fronius TAURO ECO is installed in one of the listed countries within the attached country list,
- / the solar modules installed are adequately ventilated.

However, if the MPP Min voltage of 580 V is undercut in a range of 5 percent, a temporary performance restriction of max. 1-3 percent is to be expected. This restriction has only a very slight impact on the annual energy yield (<0.25%).

Fronius International GmbH
Solar Energy Division
Froniusplatz 1
A-4600 Wels

Ing. Thomas Ringer, BSc MA
Head of Solution Management



ATTACHMENT “COUNTRIES LIST”

- / Austria
- / Belgium
- / Denmark (without Greenland)
- / Germany
- / Great Britain
- / Hungary
- / Ireland
- / Luxembourg
- / Netherland
- / Switzerland

ATTACHMENT “RECOMMENDATION ON THE SYSTEM DESIGN OF FRONIUS TAURO ECO”

When designing a photovoltaic system, the module temperature limits established on the market are -10 °C and $+70\text{ °C}$

Investigations carried out by Fronius have shown that these limits can be modified without this giving rise to adverse effects or risks during system operation.

These limits can be adjusted where necessary, depending on the environmental conditions of the system (insolation at site, site temperatures, alignment, installation type, etc.).

Maximum open circuit voltage V_{oc}

The maximum open circuit voltage that occurs is dependent on the minimum ambient temperature (T_a). In many cases, the minimum module temperature T_m can be increased from -10 °C to 0 °C in the system design. This is permitted if the actual maximum DC voltage occurring ($V_{oc,max,real}$) is below the calculated value for the maximum open circuit voltage at 1000 W/m^2 and 0 °C ($V_{oc,max}$).

Analyses have shown that, with constant ambient temperatures (in the example, $T_a = -20\text{ °C}$), the maximum open circuit voltage ($V_{oc,max}$) occurs at approx. 400 W/m^2 (with a module temperature of $T_m = -10\text{ °C}$) (see Figure 1). With lower insolation values, the module temperatures fall and the MPP voltage may increase, but the open circuit voltage will be lower.

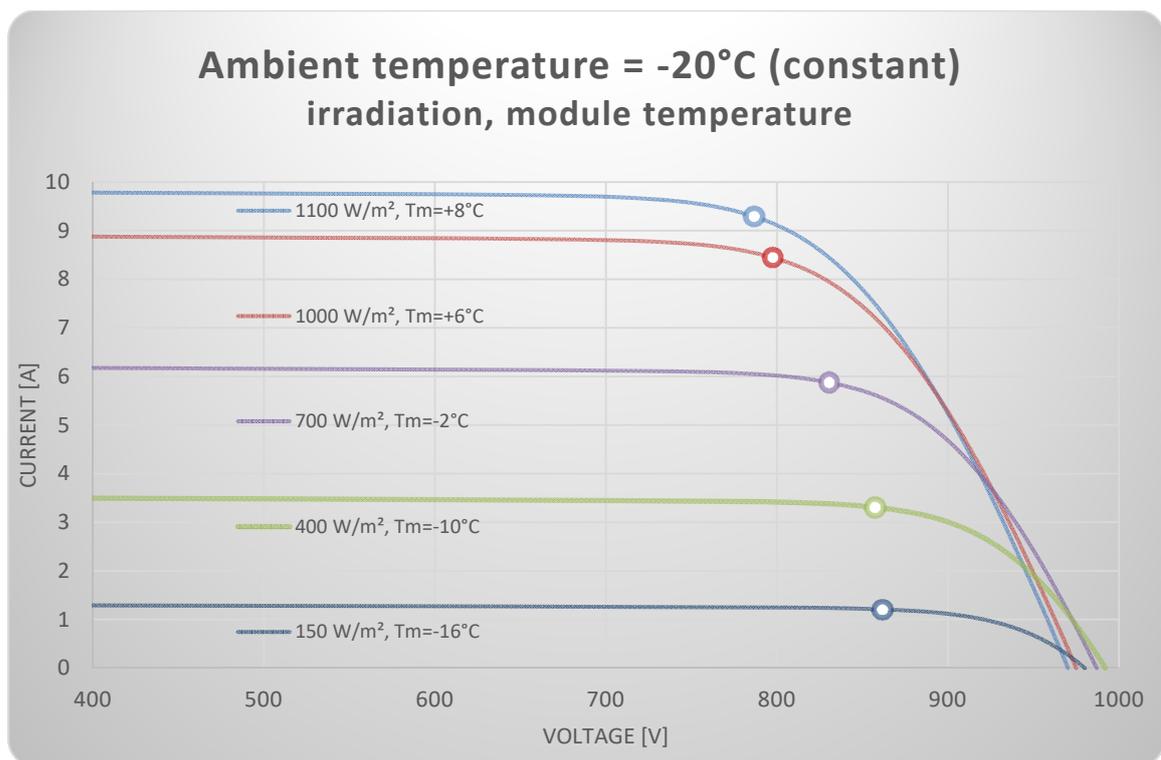


Figure 1: Characteristics $T_a = -20\text{ °C}$ (source: internal analysis - Fronius International GmbH)

The maximum open circuit voltage that occurs, calculated at 1000 W/m^2 and $T_m = 0\text{ °C}$, is just above the maximum open circuit voltage in Figure 1, while the maximum open circuit voltage calculated at 1000 W/m^2 and $T_m = -10\text{ °C}$ is significantly higher than 1000 V (see Figure 2).

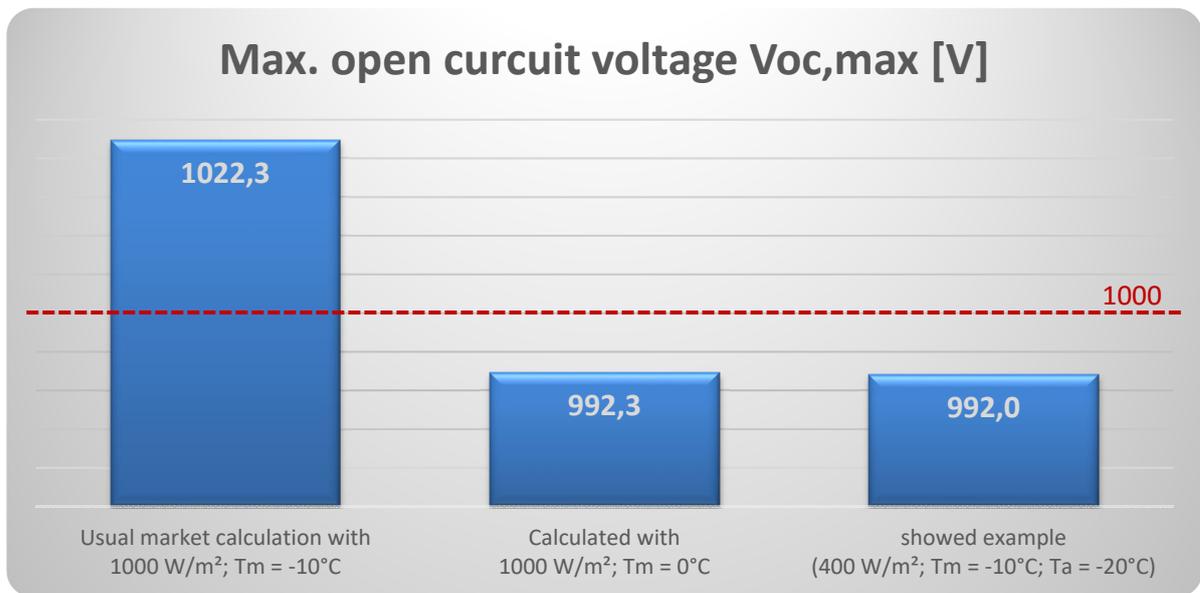


Figure 2: Max. open circuit voltage (source: internal analysis - Fronius International GmbH)

Consequently, under these conditions, calculation using an adapted minimum module temperature of T_m=0 °C is permitted.

Minimum DC voltage U_{dc,min}

The minimum MPP voltage that occurs is dependent on the maximum ambient temperature (T_a). Analyses of the module temperatures occurring have shown that, in systems installed in open spaces or on a well-ventilated roof, these temperatures lie below T_m=+60 °C, even with insolation of 1100 W/m² and an ambient temperature of T_a=+30 °C (see Figure 3).

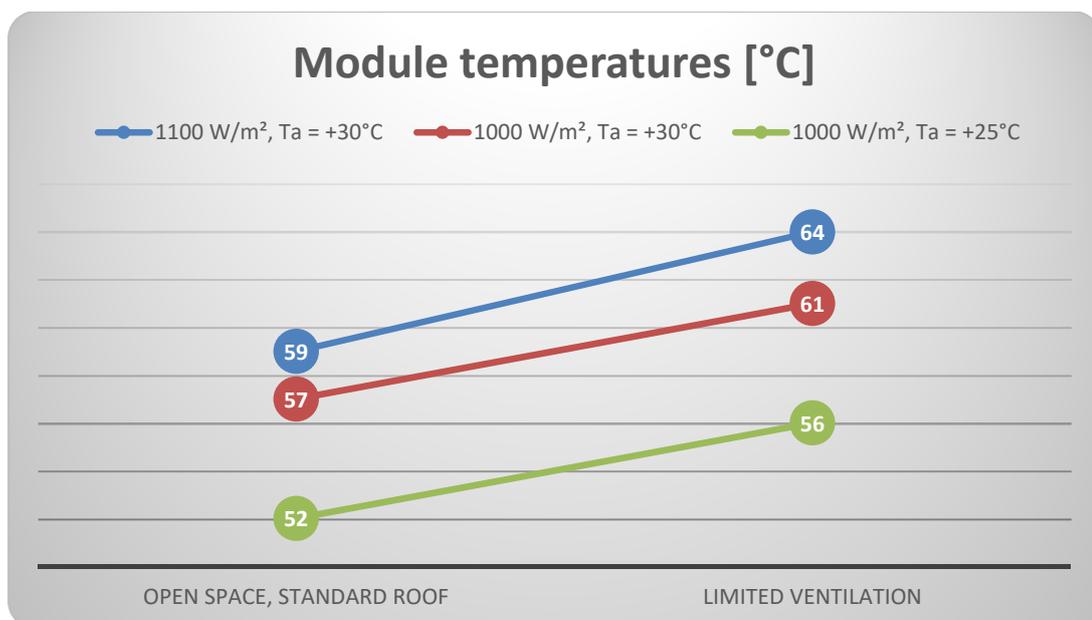


Figure 3: Module temperatures (source: internal analysis - Fronius International GmbH)

Consequently, under these conditions, calculation using an adapted maximum module temperature of T_m=+60 °C is possible.